


# Proposed Celtic Interconnector Cable Route

## Legend

- Towns
- Proposed Connection Point Knockraha
- Proposed Converter Station Site Location
- Proposed Landfall Point
- Proposed High Voltage Alternating Current (HVAC) Underground Cable Route
- Proposed High Voltage Direct Current (HVDC) Underground Cable Route
- Proposed Off-Road Cable Route

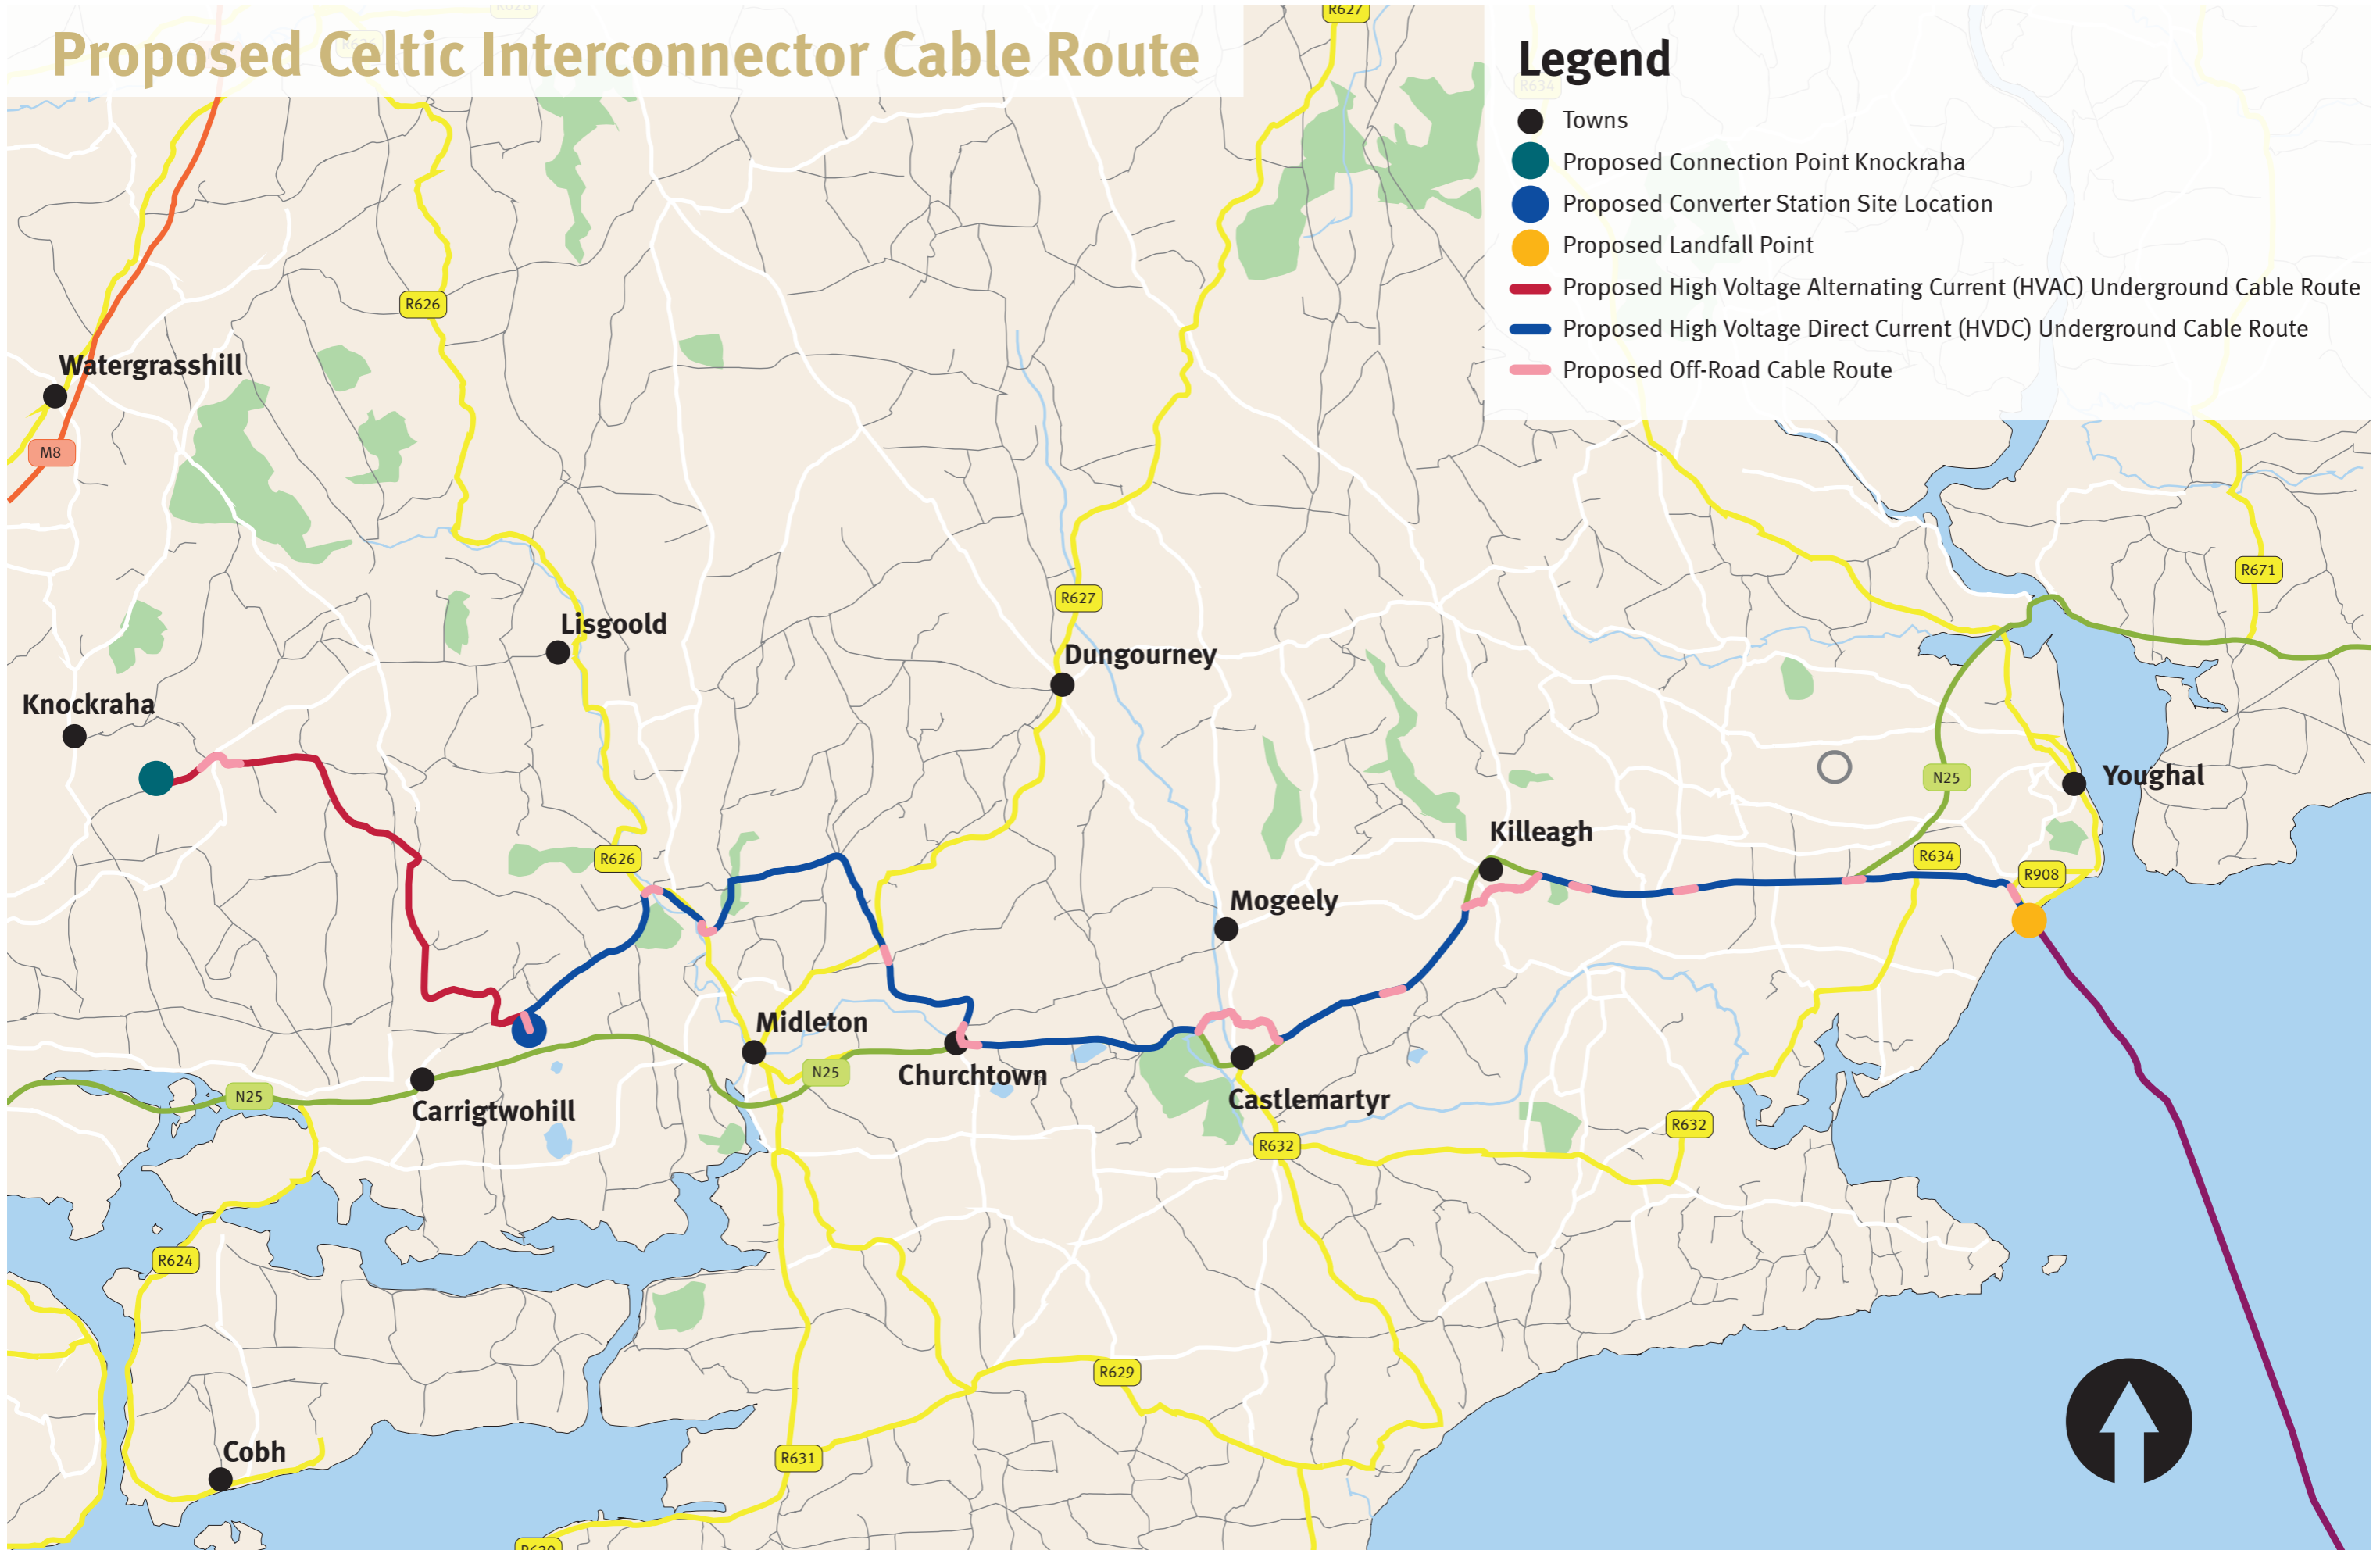

**Please Note:** Cable jointing bays will be required at regular intervals along the cable route. Passing bays to facilitate traffic flow will also be installed at these locations as required.