


LOUTH

CORDUFF 2

CORDUFF 1

MAYNOOTH

E.S.B. Standard Palisade Fence

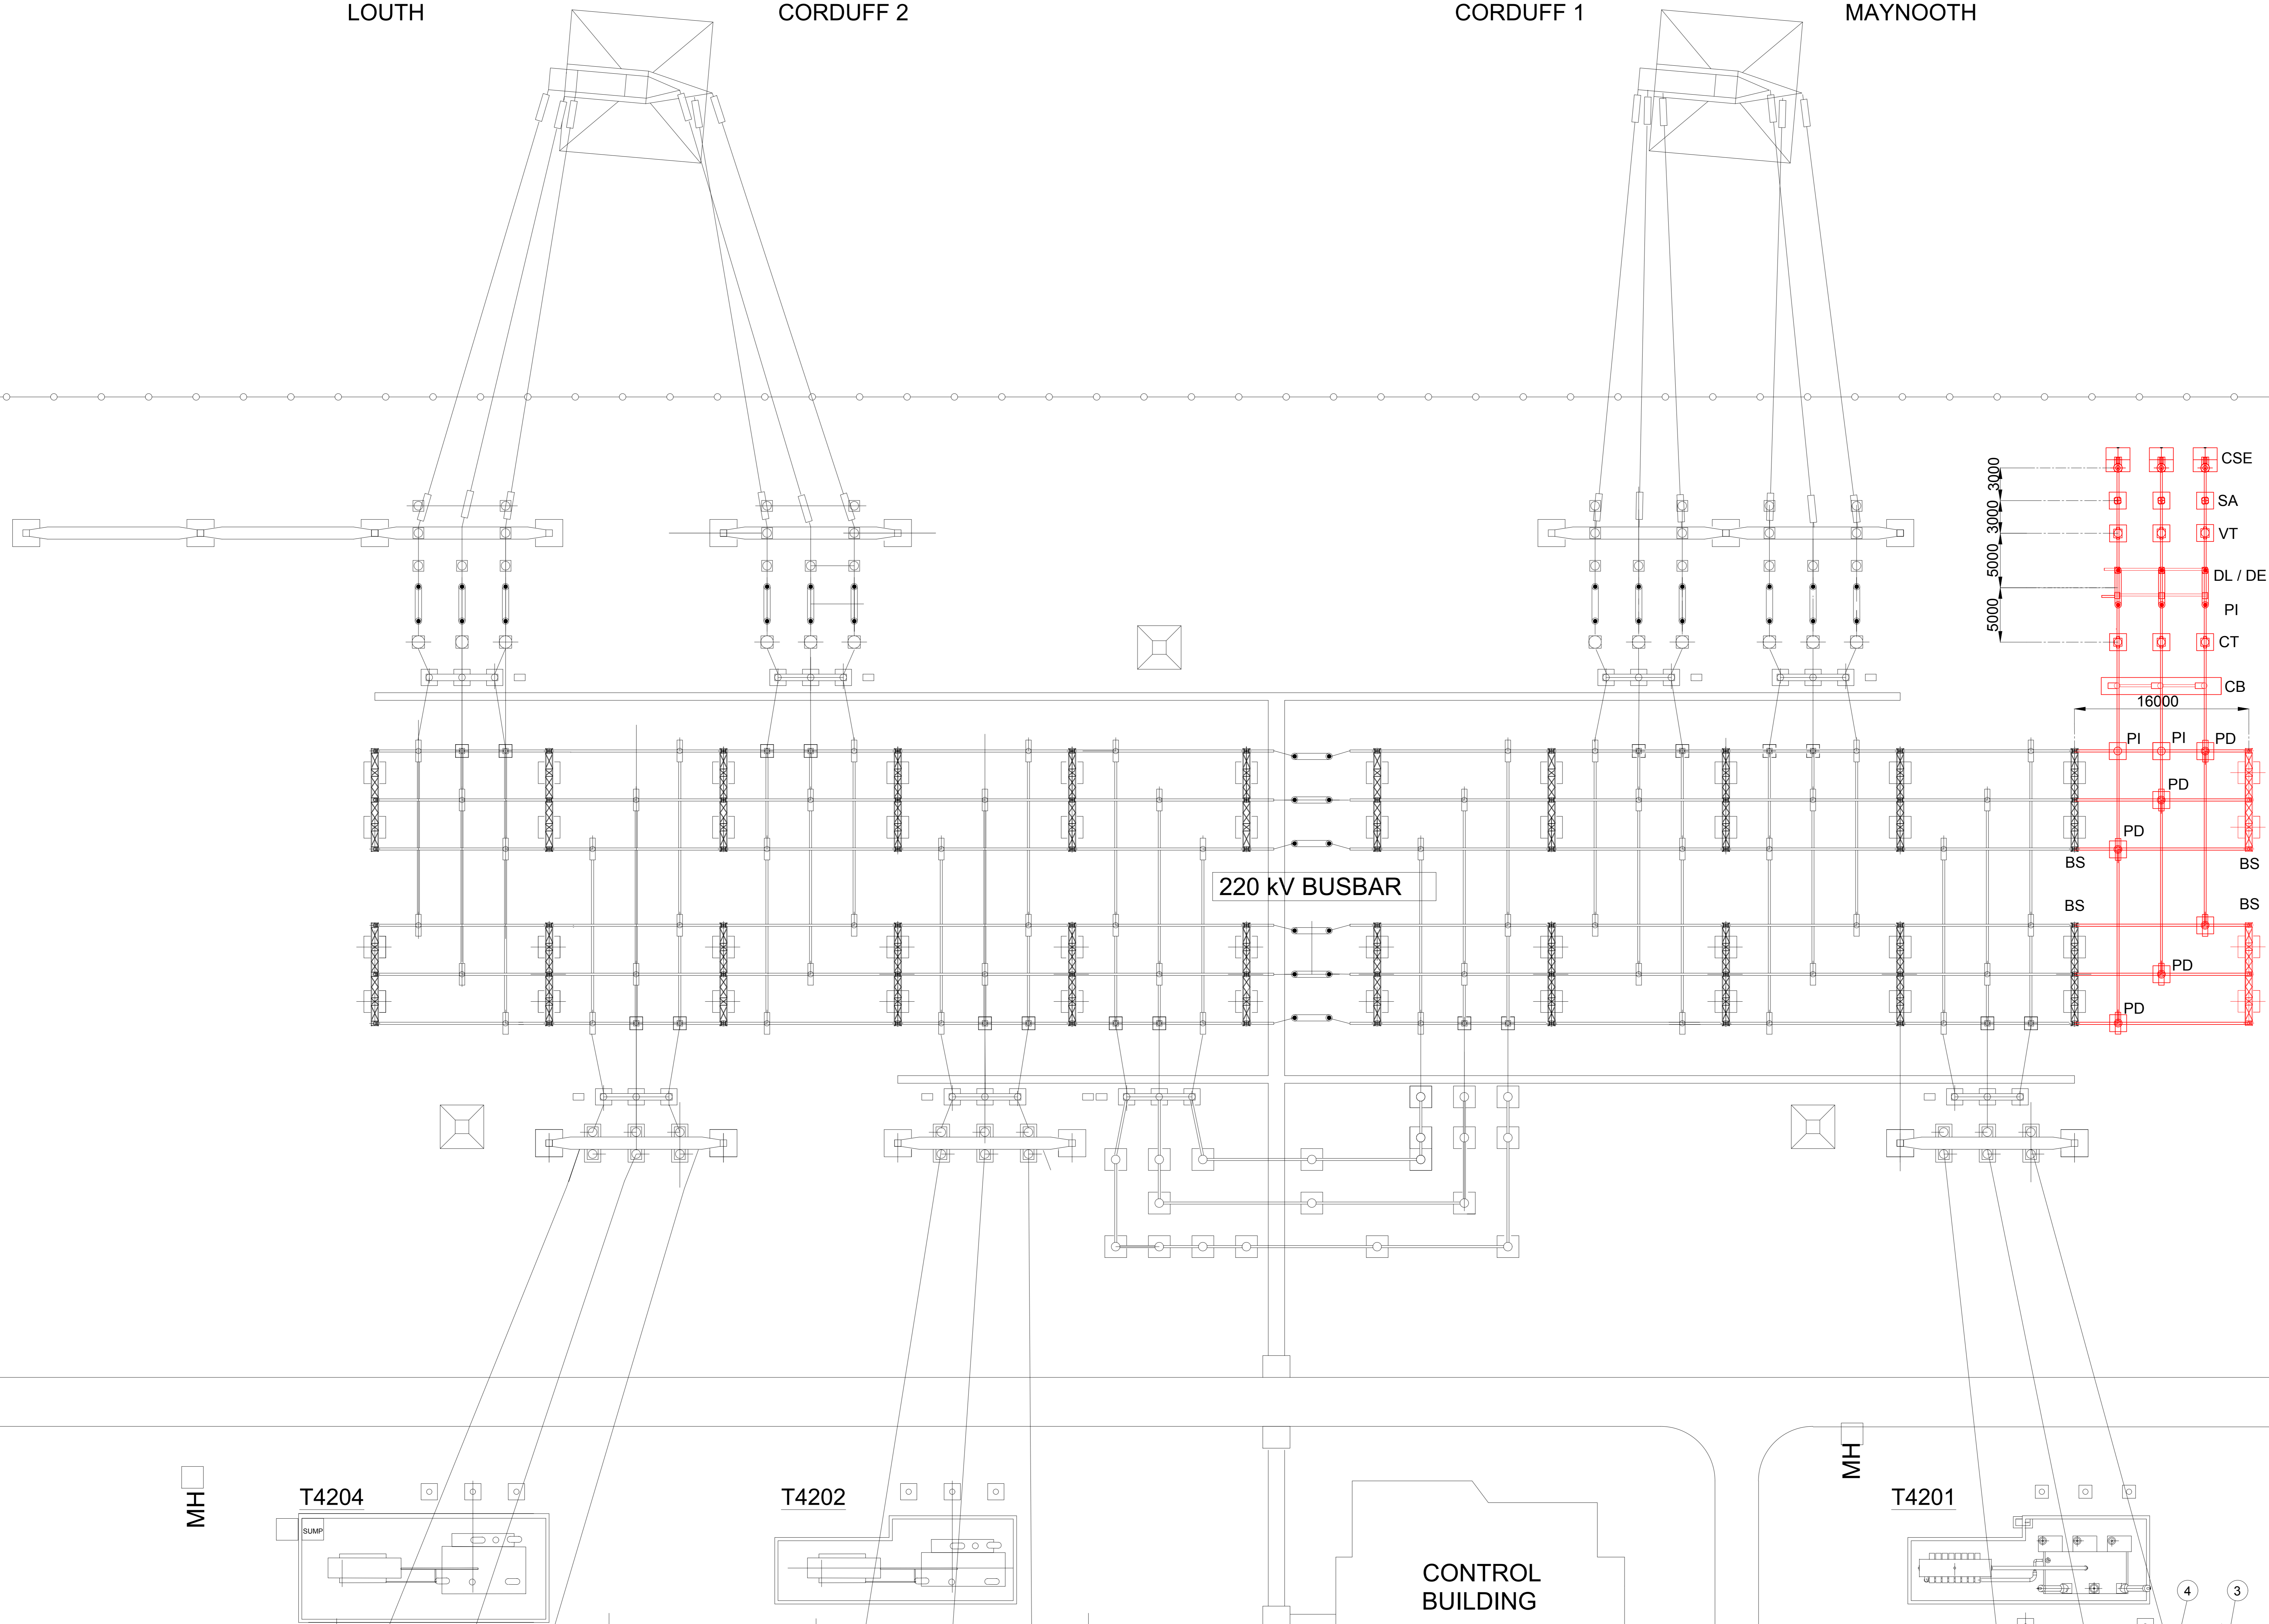

**NOTES**  
 1. This drawing is for development purposes.

**LEGEND**

—	- Existing	DL/DE - Line Disconnector/Earth
—	- New	VT - Voltage Transformer
—	- To be removed	CT - Current Transformer
—	- Work by others	PI - Post Insulator
		SH RX - Shunt Reactor
		SA - Surge Arrestor
		CB - Circuit Breaker
		CSE - Cable Sealing End

**REFERENCE DRAWINGS**  
 Meath Study Area (MSA) Woodland 400kV Substation Site Layout Plan 6244-2054

Rev	Rev. Date	Purpose of revision	Drawn	Checked	Rev'd	Apprv'd
A	31.03.2020	Final Issue	NS	SB	U	FL

© Copyright 2019 Jacobs (UK) Limited. The concepts and information contained in this document are the property of Jacobs. Use of any part of this document without the written permission of Jacobs constitutes an infringement of copyright. Jacobs and the Jacobs logo are registered trademarks of Jacobs Engineering Group Inc. and its subsidiaries. All other marks are the property of their respective owners. This drawing is for development purposes only and is not to be used for construction purposes.

**JACOBS**  
 85 Bothwell St, Glasgow, G2 7HX  
 Tel: +44(0)141 243 8000 Fax: +44(0)141 226 5100  
 www.jacobs.com

**EIRGRID**  
 EIRGRID CP966

Drawing title: **WOODLAND 220kV CP966 GORMAN CABLE CONNECTION**

Drawing status: **PRELIMINARY**

Scale: 1:350 @ A0 DO NOT SCALE

Record No: 321084AE Rev: **A**

Client no.: 321084AE

Drawing number: **321084AE-LAY-015**

C:\Users\scm\110\OneDrive - Jacobs\Engineering\Projects\Deliverables\Drawings\220kV Gorman Cable Connection Revn\_Ang - 31032020 18:28:12 - 6244-2054 - SMITH10